


For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

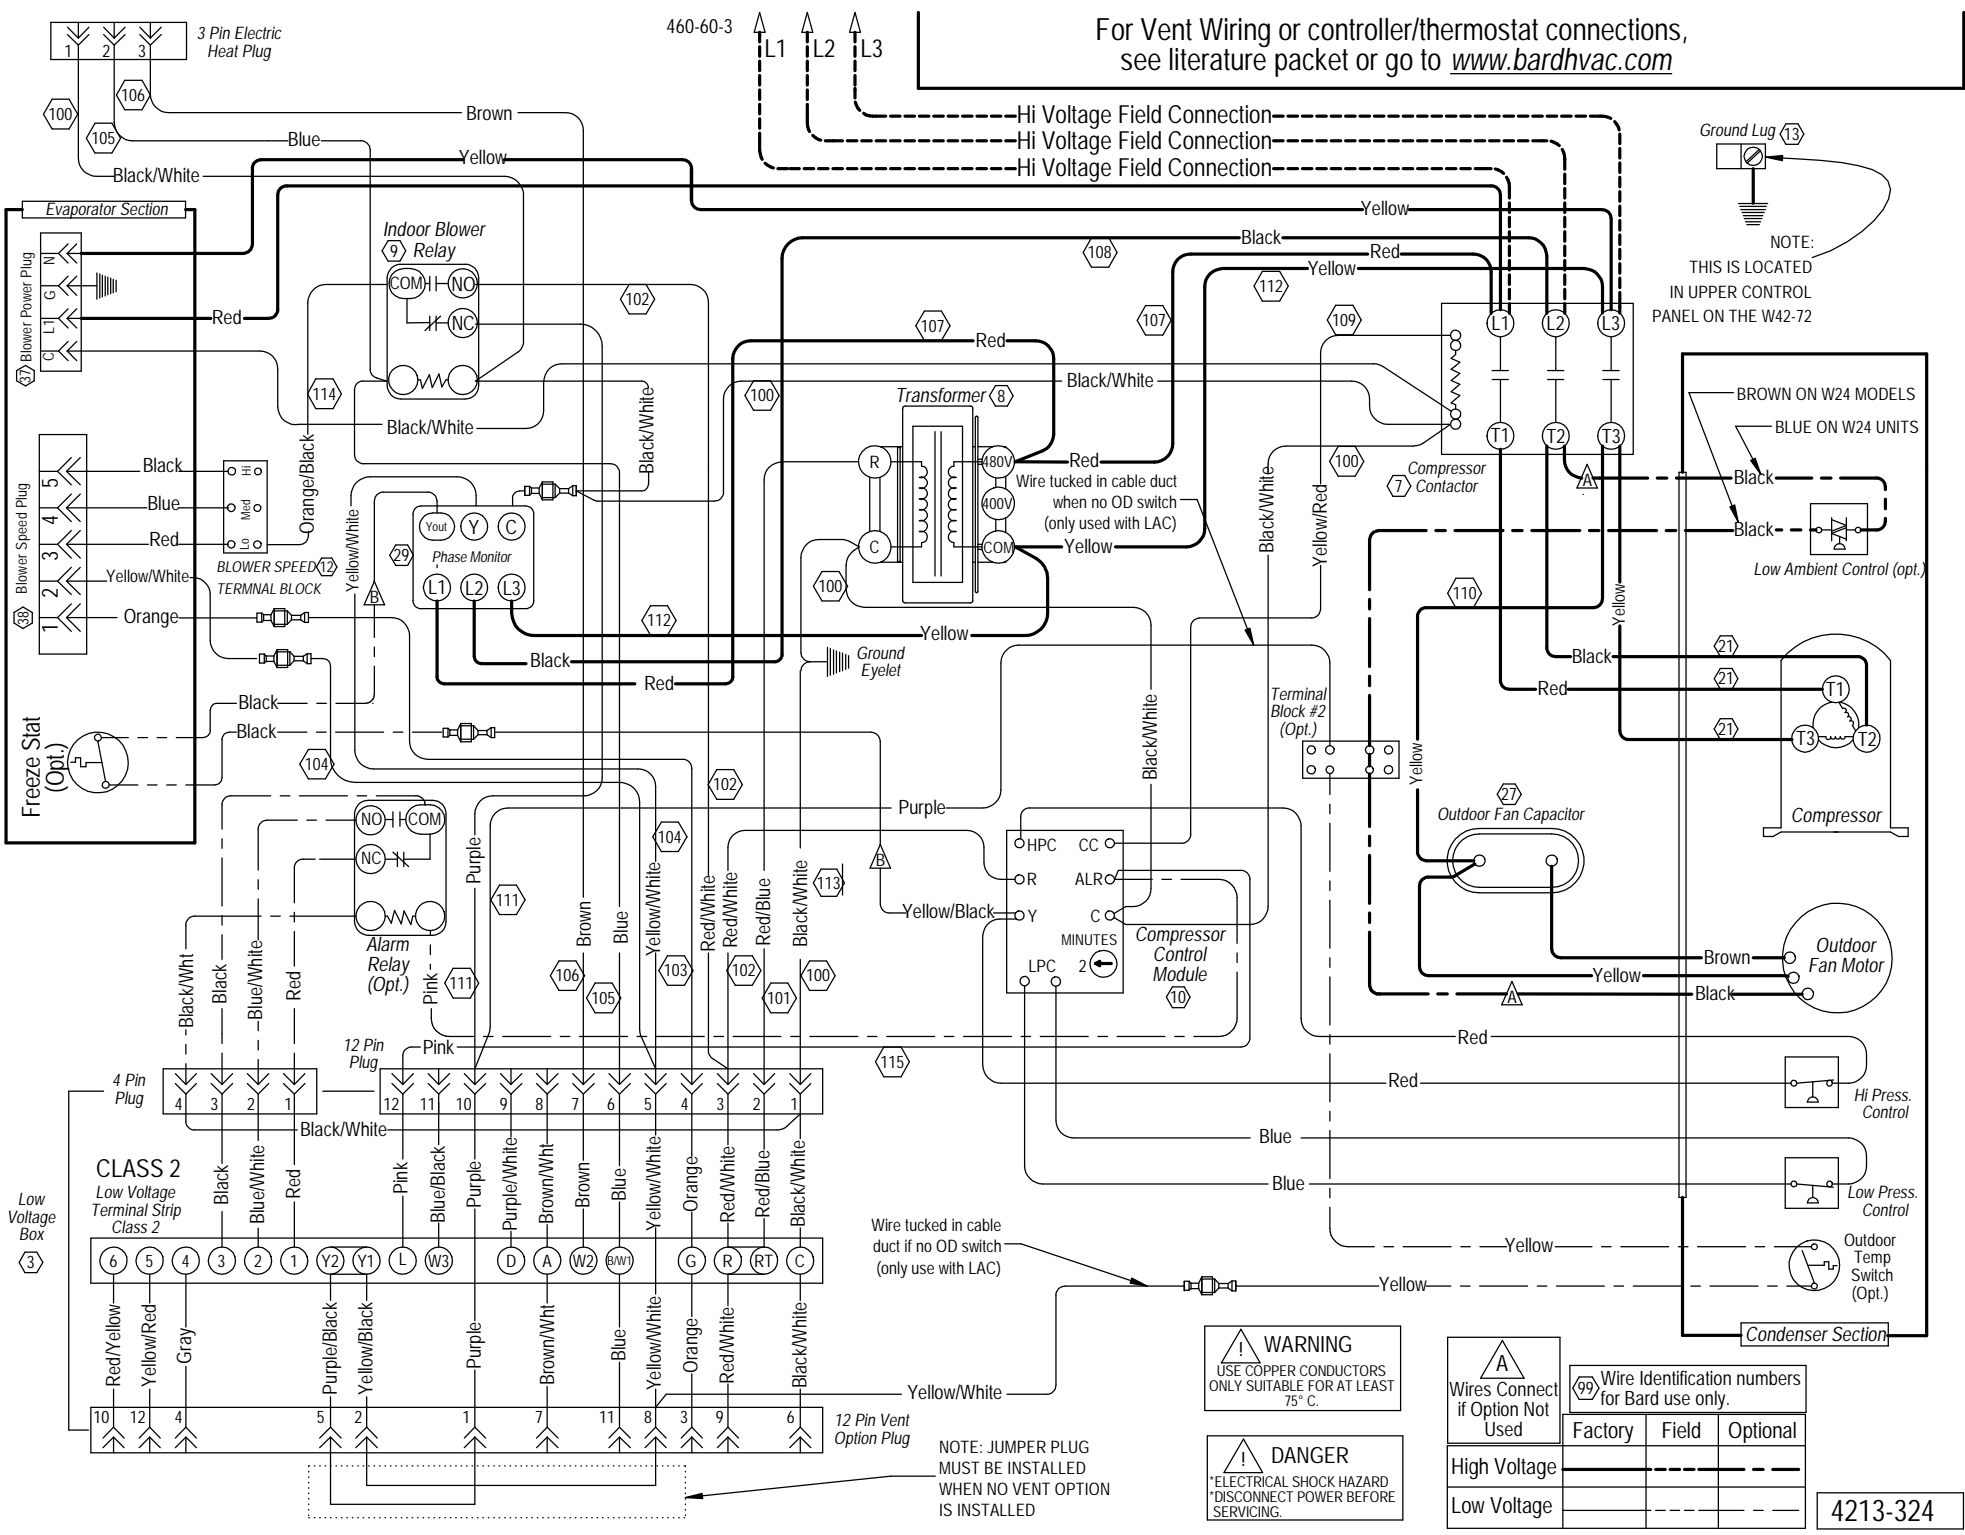

NOTE:
THIS IS LOCATED
IN UPPER CONTROL
PANEL ON THE W42-72

BROWN ON W24 MODELS
BLUE ON W24 UNITS

CLASS 2
Low Voltage
Terminal Strip
Class 2

<p>WARNING USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.</p>	<p>DANGER ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING.</p>	<p>99 Wire Identification numbers for Bard use only.</p>		
		<p>Wires Connect if Option Not Used</p>	<p>Factory</p>	<p>Field</p>
<p>High Voltage</p>	<p>Low Voltage</p>	<p>-----</p>	<p>-----</p>	<p>-----</p>

4213-324